


**Product Description****BMD4032****BMD4032 Input/output module****Application**

The input/output module BMD4032 with 32 digital inputs or outputs receives System 4000 binary signals and activates binary control functions.

The function of the 32 inputs or outputs can be individually software configured and defined for each connection.

The first 8 inputs can be used as pulse counter inputs up to 80 Hz.

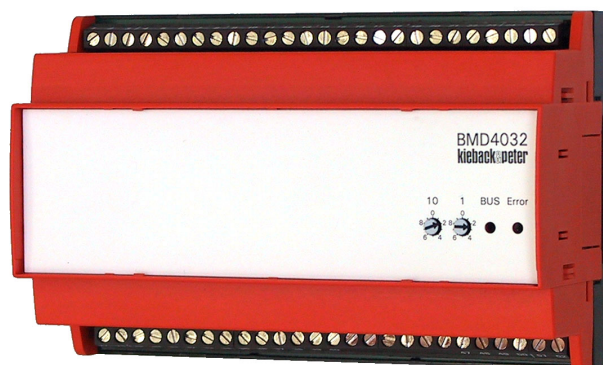

<b>Content</b>	<b>Page</b>
Important Information Regarding Product Safety .....	2
Item .....	3
Technical Data .....	3
Accessories (not included in delivery) .....	3
Dimensions .....	4
Installation .....	4
Connection .....	5
Mounting .....	6
Removal .....	6
Commissioning .....	7
Setting the Switch Cabinet Bus Address .....	7
LED Indicators .....	8

Änderungen vorbehalten - Contents subject to change - Sous réserve de modifications - Reservado el derecho a modificación - Wijzigingen voorbehouden - Con riserva di modifiche - Innehåll som skall ändras - Změny vyhrazeny - Zmiany zastrzeżone - Возможны изменения - A változtatások jogát fenntartjuk - 保留未经通知而改动的权力

## Important Information Regarding Product Safety

### Safety Instructions

This data sheet contains information on installing and commissioning the product "BMD4032". Each person who carries out work on this product must have read and understood this data sheet. If you have any questions that are not resolved by this data sheet, you can obtain further information from the supplier or manufacturer.

If the product is not used in accordance with this data sheet, the protection provided will be impaired.

Applicable regulations must be observed when installing and using the device. Within the EU, these include regulations regarding occupational safety and accident prevention as well as those from the VDE (Association for Electrical, Electronic & Information Technologies). If the device is used in other countries, it is the responsibility of the system installer or operator to comply with local regulations.

Mounting, installation and commissioning work on the devices may only be carried out by qualified technicians. Qualified technicians are persons who are familiar with the described product and who can assess given tasks and recognize possible dangers due to technical training, knowledge and experience as well as knowledge of the appropriate regulations.

### Legend



#### WARNING

Indicates a hazard of medium risk which can result in death or severe bodily injury if it is not avoided.



#### CAUTION

Indicates a hazard of low risk which can result in minor or medium bodily injury if it is not avoided.



#### CAUTION

Indicates a hazard of medium risk which can result in material damage or malfunctions if it is not avoided.



#### NOTE

Indicates additional information that can simplify the work with the product for you.

### Notes on Disposal

For disposal, the product is considered waste from electrical and electronic equipment (electronic waste) and must not be disposed of as household waste. Special treatment for specific components may be legally binding or ecologically sensible. The local and currently applicable legislation must be observed.

**Product Description****BMD4032****Item**


BMD4032                      Input/output module

**Technical Data**

Nominal voltage	<ul style="list-style-type: none"> <li>■ AC 24 V <math>\pm</math> 10%, 50 Hz to 60 Hz, 90 mA</li> <li>■ DC 24 V <math>\pm</math> 10%, 100 mA for inputs and outputs</li> </ul>
Fuse	0.25 A, delayed-action
Inputs and outputs	32, can be configured individually as binary inputs or binary outputs <ul style="list-style-type: none"> <li>■ BI: Voltage-free contacts (k1 through k8 can also be used as pulse counter inputs up to 80 Hz)</li> <li>■ BO: Transistor outputs DC 24 V, max. 40 mA</li> </ul>
Indicators and controls	2 LEDs for indicating bus communication behind the transparent cap. See chapter "LED Indicators", page 8.
Address switch	Addressing of 01 to 16 by means of 2 rotary switches
Interfaces	Switch cabinet bus
Housing	Plastic housing
Overvoltage category	III
Rated impulse voltage	800 V
Level of contamination	2
How It Works	Type 1
Degree of protection	IP20
Ambient temperature	0 °C to 45°C
Ambient humidity	20% to 80% r.h., non-condensing
Installation	Switch cabinet installed on top hat rail TH 35-7.5
Weight	285 g
Dimensions	WxHxD mm 143.5 x 90 x 60

**Accessories (not included in delivery)**

Cascade plug Z179	Different fieldbus or switch cabinet bus modules can be connected using the cascade plug. Modules are supplied even when there are inactive modules within the chain. Connected lines: all supply voltages, CAN bus (+, -, GND) A maximum of 5 modules can be connected in cascade.
-------------------	---

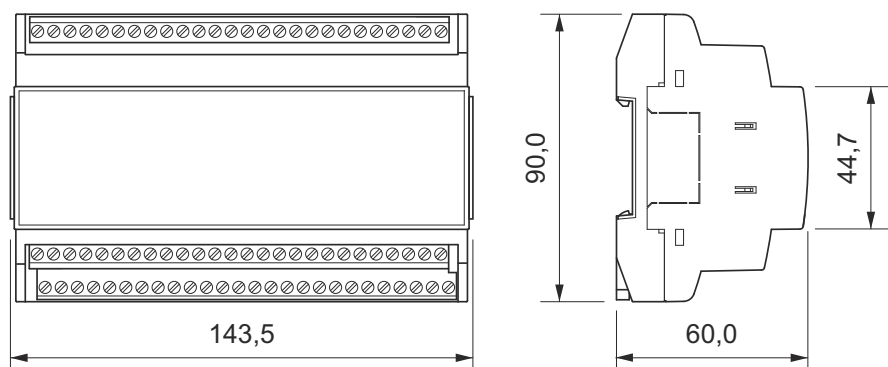**BMD4032****Product Description****Dimensions****Installation****CAUTION**

This product description describes specific settings and functions of the BMD4032. In addition to these instructions, observe the product descriptions of other system components, such as DDC controller DDC4000, BMR or DDC420.

**CAUTION**

Switching on the power supply of unparameterized products can lead to unforeseen consequences such as malfunctions or material damage.

Switch on the power only after the device has been configured by the commissioning technician.

**Switch cabinet bus**

When connecting the switch cabinet bus, use a cable of at least type JY(St)Y 2x2x0.8 Lg: two x two leads stranded into a pair, plastic insulation and an electrostatic shield with a lead diameter of at least 0.8 mm. Use a stranded pair of leads for the data lines (+ and -) and another free lead for the ground (0).

At the end of the switch cabinet bus (farthest point from the DDC controller), install a terminating resistor of about 180 ohms between both data lines (+ and -). The terminating resistor is included with the DDC controller

The maximum cable length for the switch cabinet bus is 200 m.


## Product Description

BMD4032

## Connection

**CAUTION**

Deviating GND wiring may lead to malfunction.

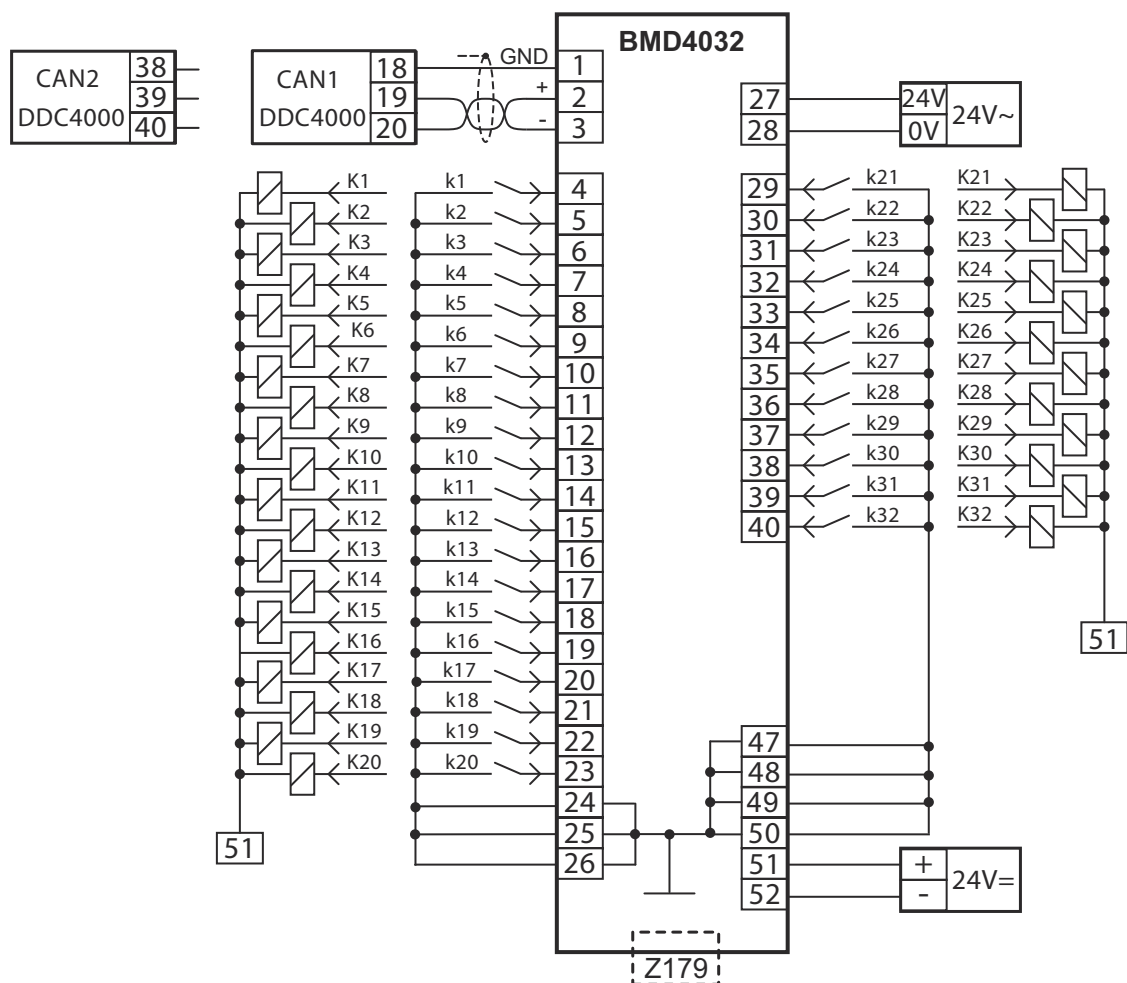


## Mounting




### WARNING

Contact with live parts of electrical domestic installation can cause death due to electric shock. Mounting/removal may only be carried out when power is switched off.

### Mounting without cascade plug

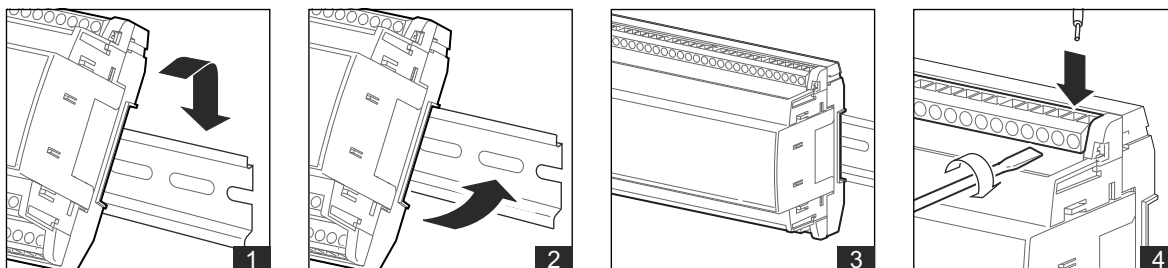

### Installation with Z179 cascade plug accessory (not included in the scope of delivery)

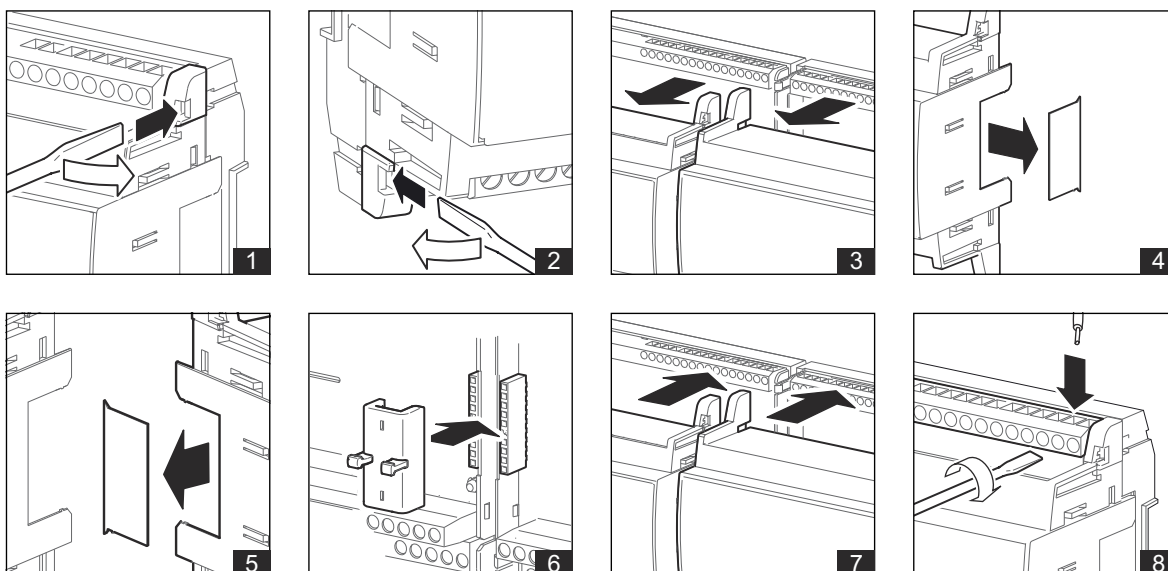


## Removal



### WARNING

Contact with live parts of electrical domestic installation can cause death due to electric shock. Mounting/removal may only be carried out when power is switched off.

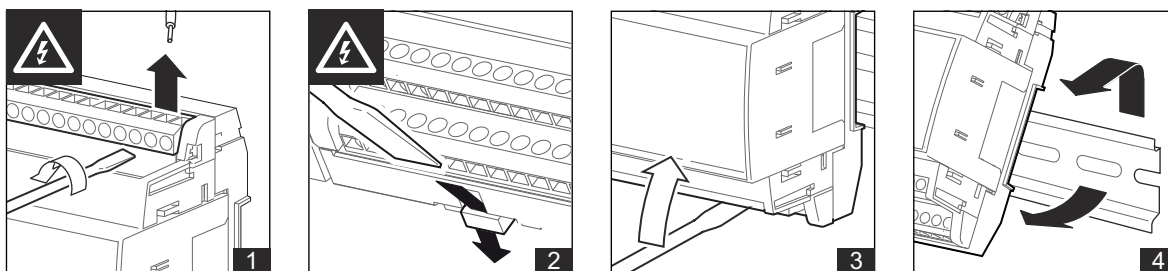

## Commissioning




### CAUTION

Commissioning by switching on the supply voltage may occur only after the commissioning technician/engineer has finished configuring the DDC and has set the fieldbus address.

- Configuration is described in the DDC controller project planning documentation.
- Before switching on the supply voltage, check the electric installation and the device connections.
- After configuring the device and switching on the supply voltage, check the functions of the module and the connected inputs and outputs.

## Setting the Switch Cabinet Bus Address

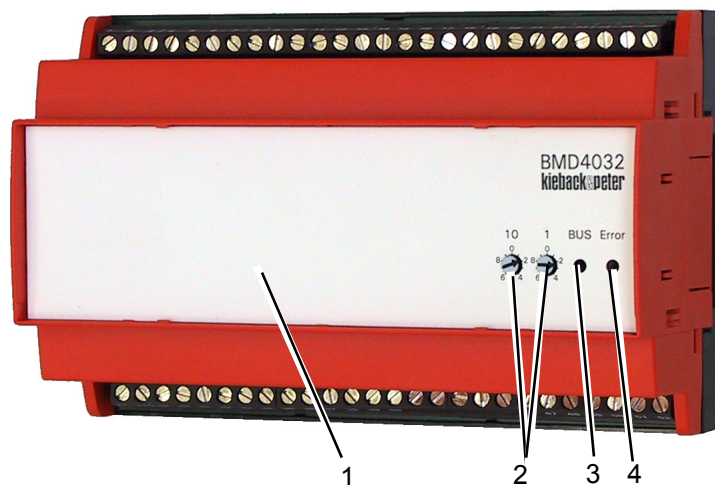

- 1 Transparent cover
- 2 Address switch
- 3 Green "BUS" LED
- 4 Red "Error" LED


Allowed range for the switch cabinet bus address: 01 to 16.

The rotary switches for setting the switch cabinet bus address are located under the Transparent cover (1).

- ▶ Starting from the bottom corner on the side, use a screwdriver (blade width < 3 mm) to lift the Transparent cover (1).
- ▶ Set the first digit of the switch cabinet bus address using the first Transparent cover (1) and the second digit using the second Address switch (2).

The example shows the address "15".

- ▶ With a little pressure, lock the Transparent cover (1) back into place.



**BMD4032****Product Description****LED Indicators**

Green "BUS" LED	Red "Error" LED	Meaning	Cause
Off	Off	Module not in operation	No operating voltage or operating voltage too low
On	On	Module in operation, but there is a bus error	Bus line short circuit (between a bus line and either ground or other another bus line) Bus lines mixed up Bus line(s) interrupted
Flashing	Flashing	Address error, no bus activity	Outside of address range #01 to #16 Address assigned multiple times
Flashing	On	Address error	Address not registered in controller
Flashing	Off	Module OK, bus activity	
Flashing, alternating between green and red		Hardware problem	Polarity of the DC 24 V contacts reversed